



7505 S. Holden Street
Midvale, Utah 84047
Office: 801.567.7200
Fax: 801.567.0518

Service Change Disclosure

Address _____ RMP work order # _____

Building use or description _____

of meters existing _____ proposed _____ size _____

Location of the existing meter _____

Location of the proposed meter _____

Does this project include a sub panel? _____

Description of additional work _____

Any work to the interior of the home is subject to the following:

R314.2.2 Alterations, repairs and additions. Where *alterations, repairs* or *additions* requiring a permit occur, or where one or more sleeping rooms are added or created in existing *dwelling units*, the individual *dwelling unit* shall be equipped with smoke alarms located as required for new *dwelling units*.

R314.3 Location. Smoke alarms shall be installed in the following locations:

1. In each sleeping room.
2. Outside each separate sleeping area in the immediate vicinity of the bedrooms.
3. On each additional *story* of the *dwelling unit*, including *basements* and *habitable attics* and not including crawl spaces and uninhabitable *attics*. In *dwelling units* or *dwelling units* with split levels and without an intervening door between the adjacent levels, a smoke alarm installed on the upper level shall suffice for the adjacent lower level provided that the lower level is less than one full *story* below the upper level.
4. Smoke alarms shall be installed not less than 3 feet (914 mm) horizontally from the door or opening of a bathroom that contains a bathtub or shower unless this would prevent placement of a smoke alarm required by Section R314.3.

R314.6 Power source. Smoke alarms shall receive their primary power from the building wiring where such wiring is served from a commercial source and, where primary power is interrupted, shall receive power from a battery. Wiring shall be permanent and without a disconnecting switch other than those required for overcurrent protection.


Exceptions:

1. Smoke alarms shall be permitted to be battery operated where installed in buildings without commercial power.
2. Smoke alarms installed in accordance with Section R314.2.2 shall be permitted to be battery powered. Where feasible, (i.e. exposed areas and accessible attics) permanent wiring shall be installed.

R315.3 Location. Carbon monoxide alarms in *dwelling units* shall be installed *on each level of the dwelling unit and* outside of each separate sleeping area in the immediate vicinity of the bedrooms. Where a fuel-burning *appliance* is located within a bedroom or its attached bathroom, a carbon monoxide alarm shall be installed within the bedroom.

4.2.1 Clearances for Buildings Supporting an Overhead Service

Figure 4—Clearances for Buildings Supporting an Overhead Service

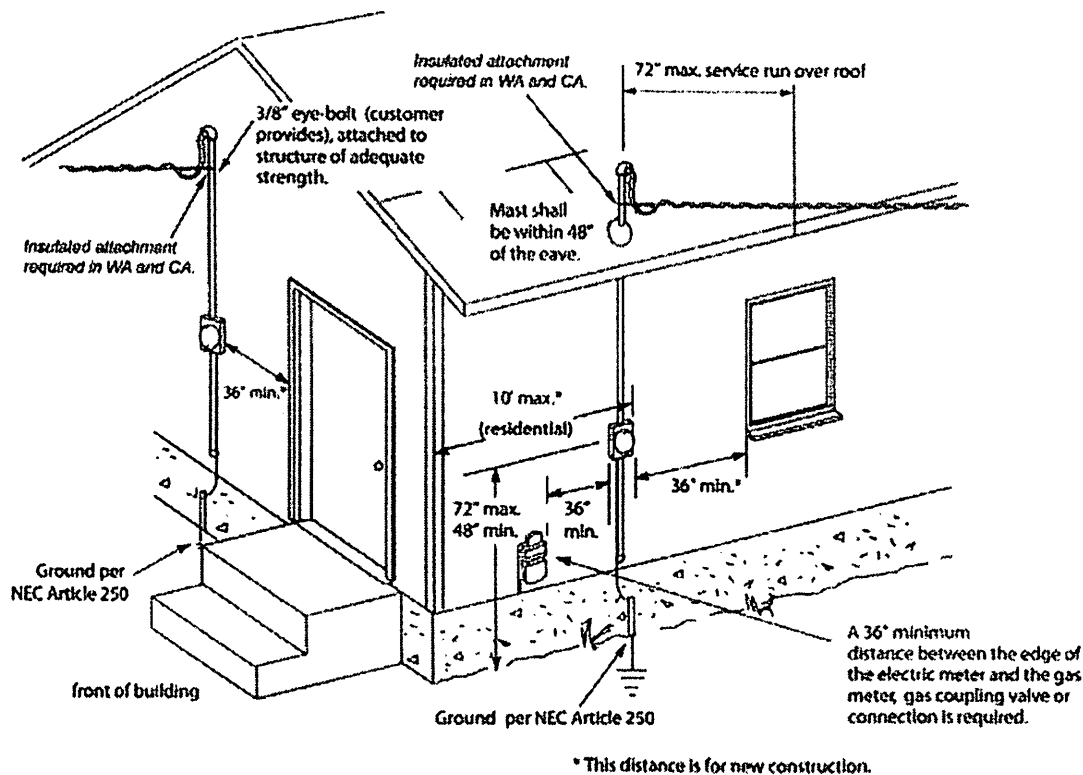

Requirements:

1. A ten-foot maximum distance from the front corner of a residential building to the far side of the meter is allowed.
2. Table 6 and Table 7 list the minimum drip loop and service drop clearance requirements.
3. The cable and drip loop (lowest point) shall be at least 18 inches (18") above a non-accessible roof (NESC 234.C.3.d, Exceptions 1 and 2).
4. Meters shall not be installed within 36 inches (36") of a window that has a view of living space or restrooms, or within 36 inches (36") of a door (*guideline*).
5. The customer must install residential meters outdoors at a location acceptable to the Power Company and in accordance with Figure 4.
6. Buildings shall not be constructed under or adjacent to power lines.
7. For further details regarding meter clearances and locations, see Section 4.1.

